


## C-Series - Condenser Rear Discharge Assembly w/ Rear Access

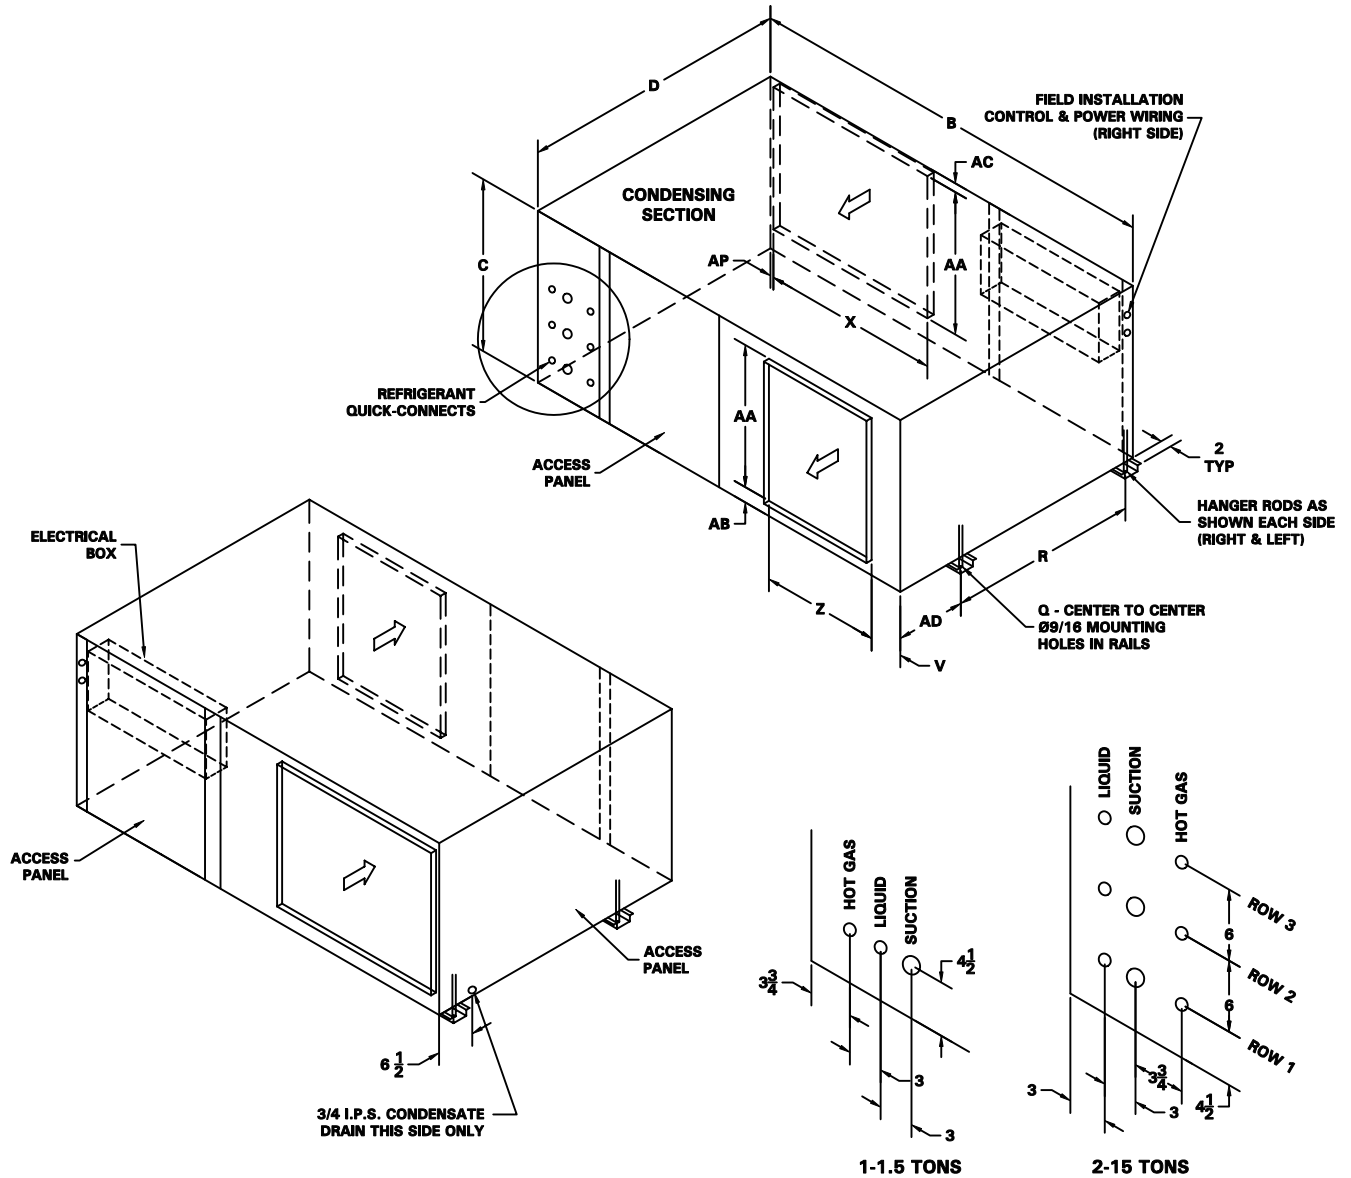

NOTE: MOUNTING RAIL HEIGHT AND DUCT FLANGE 1" TYP

TONS	B	C	D	Q	R	V	X	Z	AA	AB	AC	AD	AP	PIPING OUTLET LOCATIONS
1-1.5 SINGLE CIRCUIT	35 <sup>15</sup> / <sub>16</sub>	16	29 <sup>9</sup> / <sub>16</sub>	37 <sup>5</sup> / <sub>16</sub>	25 <sup>1</sup> / <sub>4</sub>	4 <sup>15</sup> / <sub>16</sub>	12	12 <sup>1</sup> / <sub>16</sub>	12	2 <sup>3</sup> / <sub>4</sub>	1 <sup>1</sup> / <sub>4</sub>	2 <sup>3</sup> / <sub>16</sub>	<sup>5</sup> / <sub>8</sub>	
2-5 SINGLE CIRCUIT	47 <sup>3</sup> / <sub>8</sub>	22	34 <sup>3</sup> / <sub>4</sub>	48 <sup>3</sup> / <sub>4</sub>	21 <sup>9</sup> / <sub>16</sub>	4 <sup>11</sup> / <sub>16</sub>	16	16	16	4 <sup>11</sup> / <sub>16</sub>	1 <sup>3</sup> / <sub>16</sub>	11 <sup>1</sup> / <sub>8</sub>	<sup>1</sup> / <sub>2</sub>	ROW 1
4-8 DUAL CIRCUIT	55 <sup>3</sup> / <sub>8</sub>	27	40 <sup>3</sup> / <sub>8</sub>	56 <sup>3</sup> / <sub>4</sub>	27 <sup>1</sup> / <sub>4</sub>	3 <sup>11</sup> / <sub>16</sub>	18	18	20	4 <sup>11</sup> / <sub>16</sub>	2 <sup>3</sup> / <sub>16</sub>	11 <sup>1</sup> / <sub>8</sub>	<sup>5</sup> / <sub>8</sub>	ROWS 1 & 2
10 DUAL CIRCUIT	70 <sup>5</sup> / <sub>8</sub>	29	45 <sup>5</sup> / <sub>16</sub>	72 <sup>1</sup> / <sub>16</sub>	32 <sup>1</sup> / <sub>8</sub>	5 <sup>5</sup> / <sub>8</sub>	30	20	24	3 <sup>1</sup> / <sub>2</sub>	1 <sup>1</sup> / <sub>2</sub>	11 <sup>1</sup> / <sub>8</sub>	<sup>5</sup> / <sub>8</sub>	ROWS 1 & 3
12-15 TRIPLE CIRCUIT	70 <sup>5</sup> / <sub>8</sub>	29	45 <sup>5</sup> / <sub>16</sub>	72 <sup>1</sup> / <sub>16</sub>	32 <sup>1</sup> / <sub>8</sub>	5 <sup>5</sup> / <sub>8</sub>	30	20	24	3 <sup>1</sup> / <sub>2</sub>	1 <sup>1</sup> / <sub>2</sub>	11 <sup>1</sup> / <sub>8</sub>	<sup>5</sup> / <sub>8</sub>	ROWS 1, 2 & 3

491 East Princess Street • York, Pennsylvania 17403 • 717-843-4311 • Toll Free 877-905-1111 • fax: 717-854-4462

www.unitedcoolair.com • uca@unitedcoolair.com

CA11104(A)(11)  
04/14/09